

GENERAL NOTES:

1. REFER TO APPLICABLE FORTIFIED HOME STANDARDS FOR ADDITIONAL INFORMATION.
2. APPLICABLE FOR ROOF PITCH 2:12 OR GREATER.
3. REFER TO AND INSTALL IN ACCORDANCE WITH MANUFACTURER SPECIFICATIONS AND INSTALLATION INSTRUCTIONS AND FRSA/TRI FLORIDA HIGH WIND TILE INSTALLATION MANUAL REVISED 5TH EDITION (FOR ASCE 7-10) OR 6TH EDITION (FOR ASCE 7-16). REFER TO PRODUCT APPROVAL TO VERIFY REQUIRED WIND PRESSURES ARE MET IF APPLICABLE.
4. ADEQUATE ATTIC VENTILATION IS REQUIRED. REFER TO UNDERLAYMENT AND PRIMARY ROOF SYSTEM MANUFACTURER'S INSTALLATION INSTRUCTIONS FOR VENTILATION LIMITATIONS. ALSO CHECK WITH LOCAL BUILDING CODES FOR RESTRICTIONS.
5. FORTIFIED HOME STANDARDS ARE TO BE APPLIED IN CONJUNCTION WITH FEDERAL, STATE, AND LOCAL CODES, ORDINANCES AND REGULATIONS IN ADDITION TO THE STRUCTURAL DESIGN WHICH IS BY OTHERS. IN CASE OF A CONFLICT BETWEEN PROVISIONS, USE WHICHEVER IS MORE STRINGENT.

ROOF SHEATHING 15/32" MIN ; REFER TO FORTIFIED STANDARD DETAILS F-RS-1, F-RS-2, AND F-RS-3. APPLY MANUFACTURER-SPECIFIED COMPATIBLE PRIMER TO ROOF SHEATHING PER MANUFACTURER INSTALLATION INSTRUCTIONS.


4" MIN. SIDELAPS OR GREATER IF SPECIFIED BY MANUFACTURER'S SPECIFICATIONS AND INSTALLATION INSTRUCTIONS AND FRSA/TRI MANUAL (SEE GENERAL NOTE #3).

ASTM D1970 SELF-ADHERING POLYMER-MODIFIED BITUMEN MEMBRANE (40 MIL MIN. THICKNESS SBS, APP OR APPROVED EQUAL) COMPATIBLE WITH TILE ROOF ASSEMBLY COVERING ENTIRE ROOF DECK. REFER TO GENERAL NOTES #3 AND #4.

REFER TO MANUFACTURER'S SPECIFICATIONS AND FRSA/TRI MANUAL (SEE GENERAL NOTE #3) FOR REQUIRED OVERLAP AND FOLLOW INSTALLATION INSTRUCTIONS.

STAGGER AND INSTALL END LAPS AS SPECIFIED PER FRSA/TRI MANUAL (SEE GENERAL NOTE #3).

DRIP EDGE SHALL BE INSTALLED PER F-DE-1

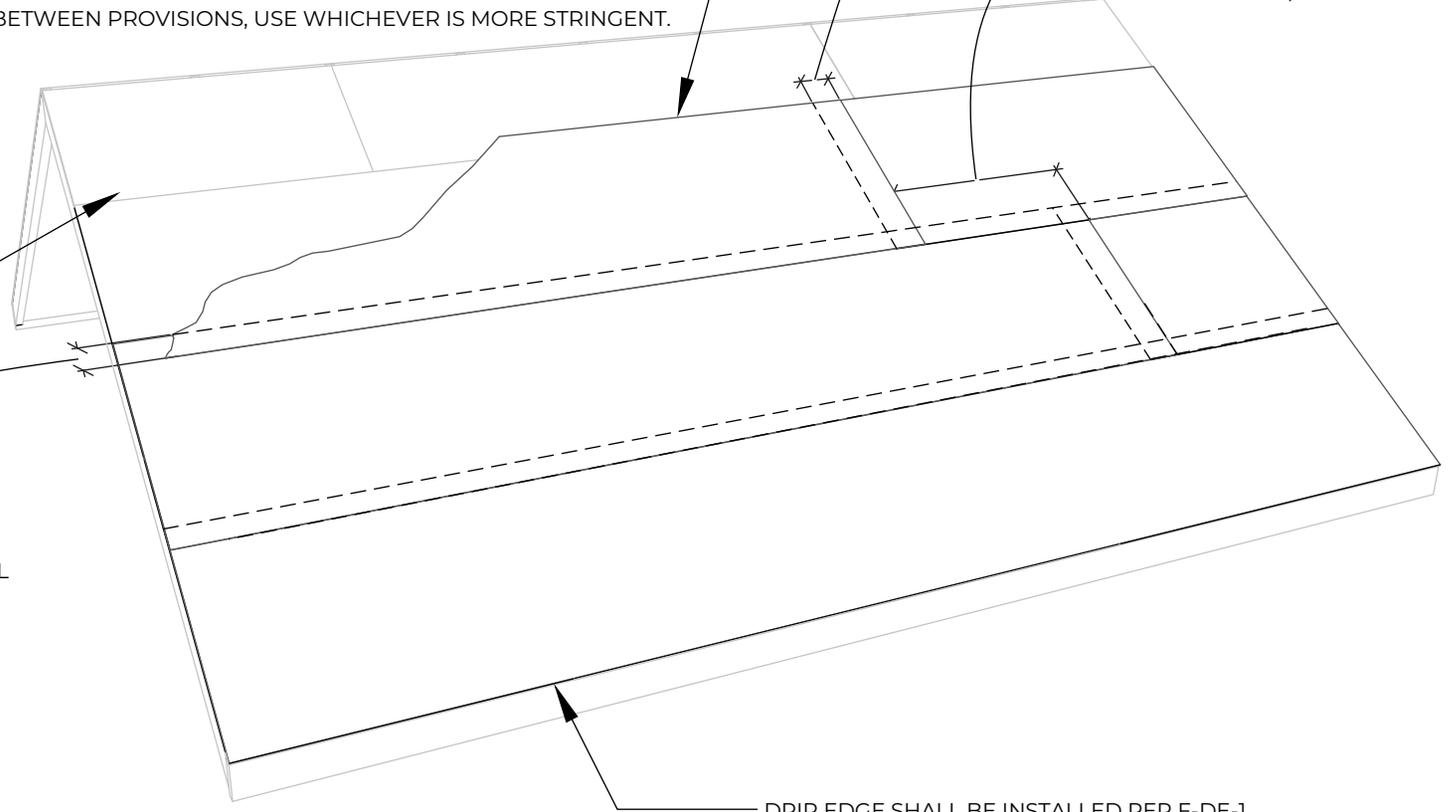

APPLICABLE STANDARDS:

FORTIFIED HOME™ - HURRICANE (2020)
 FORTIFIED HOME™ - HIGH WIND (2020)

DESCRIPTION:

STEEP SLOPE SEALED ROOF DECK - SELF-ADHERED MEMBRANE - CONCRETE AND CLAY TILE ROOF COVERS

DRAWING #:

F-SRD-6

DATE:

11/01/2020